INSTRUCTION MANUAL

DC CURRENT OUTPUT MODULE

(4 points, non-isolated, Tension clamp terminal block)

MODEL R8-YST4N

BEFORE USE

Thank you for choosing M-System. Before use, please check contents of the package you received as outlined below. If you have any problems or questions with the product, please contact M-System's Sales Office or representatives.

■ PACKAGE INCLUDES:

| DC current output module(1) |
|-----------------------------|
|-----------------------------|

■ MODEL NO.

Confirm Model No. marking on the product to be exactly what you ordered.

■ INSTRUCTION MANUAL

This manual describes necessary points of caution when you use this product, including installation, connection and basic maintenance procedures.

POINTS OF CAUTION

■ CONFORMITY WITH EU DIRECTIVES

- The equipment must be mounted inside a panel.
- The actual installation environments such as panel configurations, connected devices and connected wires may affect the protection level of this unit when it is integrated in a panel system. The user may have to review the CE requirements in regard to the whole system and employ additional protective measures to ensure CE conformity.

■ GENERAL PRECAUTIONS

- Before you remove or mount the unit, turn off the power supply and output signal for safety.
- Switches on the side of the module can be set for maintenance only while the power supply is off. Do not access them while the power is supplied.

ENVIRONMENT

- Indoor use.
- When heavy dust or metal particles are present in the air, install the unit inside proper housing with sufficient ventilation.
- Do not install the unit where it is subjected to continuous vibration. Do not subject the unit to physical impact.
- Environmental temperature must be within -10 to +55°C $(14 \text{ to } 131^\circ F)$ with relative humidity within 30 to 90% RH in order to ensure adequate life span and operation.

■ WIRING

- Do not install cables close to noise sources (relay drive cable, high frequency line, etc.).
- Do not bind these cables together with those in which noises are present. Do not install them in the same duct.


■ AND

• The unit is designed to function as soon as power is supplied, however, a warm up for 10 minutes is required for satisfying complete performance described in the data sheet.


INSTALLATION

■ HOW TO MOUNT THE MODULE ON DIN RAIL


I/O Module




Confirm that the locking clamps of the I/O module are set. Insert the module in parallel to the next one while aligning the grooves of both modules (A & B in the above figure). Maintain it perpendicularly to the rail.



More I/O modules can be added in the same manner.




• Protective Cover




The protective cover is to be attached over the connected I/O module at the right end.

Align the hooks on the cover with the grooves of the module and slide it straight until the hooks are latched.





When removing the cover, pull it out while squeezing the hooks inward.




■ HOW TO UNMOUNT THE MODULE ON DIN RAIL


Release the locking clamps and pull out straight the module.





• Removing an intermediate module






Caution !

- 1) Be careful not to hurt your hand by pointed edges of the internal communication bus connector.
- 2) I/O modules cannot hold tightly on the DIN rail by themselves without power/network module.

. Secure them to the position if necessary by using DIN rail end plates.

COMPONENT IDENTIFICATION

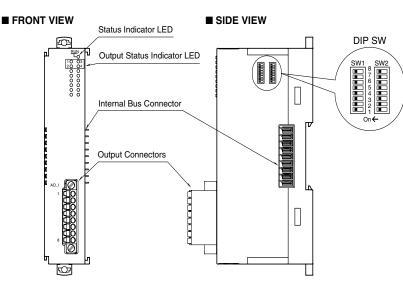

■ INDICATOR LED

| LED | OPERATION | FUNCTION |
|--------|----------------|-------------------------------|
| Status | OFF | Stopping |
| | Green ON | Valid host communication |
| | Green Blinking | Reading/writing configuration |
| | Red ON | Setting error |
| | Red Blinking | Parameter error |
| Output | OFF | Output data in the range |
| Status | Red Blinking | Output data out of range |

■ OUTPUT CONNECTOR ASSIGNMENT

| _ | PIN No. | ID | FUNCTION |
|--------------|---------|-------|--------------|
| | 1 | Out 1 | Output 1 (+) |
| | 2 | | Output 1 (–) |
| đŏ | 3 | Out2 | Output 2 (+) |
| | 4 | | Output 2 (–) |
| Φŏ | 5 | Out3 | Output 3 (+) |
| 8 <u>H</u> O | 6 | | Output 3 (–) |
| 10 | 7 | Out4 | Output 4 (+) |
| | 8 | | Output 4 (–) |

■ Module Address

The SW1-1, SW1-2, SW1-3, SW1-4 determines the tenth place digit, while the SW1-5, SW1-6, SW1-7, SW1-8 does the ones place digit of the address.

Address is selected between 0 to 30.

(Factory setting: 0)

| | | | SW1 | | |
|----------------|-----|-----|-----|-----|-----|
| MODULE ADDRESS | ×10 | 1 | 2 | 3 | 4 |
| | ×1 | 5 | 6 | 7 | 8 |
| 0 | | OFF | OFF | OFF | OFF |
| 1 | | OFF | OFF | OFF | ON |
| 2 | | OFF | OFF | ON | OFF |
| 3 | | OFF | OFF | ON | ON |
| 4 | | OFF | ON | OFF | OFF |
| 5 | | OFF | ON | OFF | ON |
| 6 | | OFF | ON | ON | OFF |
| 7 | | OFF | ON | ON | ON |
| 8 | | ON | OFF | OFF | OFF |
| 9 | | ON | OFF | OFF | ON |

■ OPERATING MODE

(*) Factory setting

Output Range

Same range for all channels. Use PC Configurator to set independent ranges per channel.

| OUTPUT RANGE | SW2-1 |
|------------------|-------|
| 0 – 20 mA DC | OFF |
| 4 – 20 mA DC (*) | ON |

· Output at The Loss of Communication

Same output for all channels.

| OUTPUT AT THE LOSS OF COMMUNICATION | SW2-5 |
|---|-------|
| Output Hold (*) (last data correctly received is hold) | OFF |
| Stop output | ON |

Note: For Stop output, output fixed at -5%, 0 mA min. when configuration mode is DIP switch setting. Output fixed at scaling value at the loss of communication when configuration mode is PC.

Terminator DIP SW

| TERMINATOR SW | SW2-6 |
|---------------|-------|
| Without (*) | OFF |
| With | ON |

Configuration Mode

| CONFIGURATION MODE | SW2-8 |
|-----------------------------------|-------|
| DIP switch setting (*) | OFF |
| PC Configurator and communication | ON |

Note: Be sure to set unused SW2-2 through 2-4 and 2-7 to OFF.

■ PC CONFIGURATOR


The following parameters can be set with using PC Configurator Software (model: R8CFG):


- Output setting by channels (range, scaling, zero/gain adjustments, scaling value at power on, scaling value at the loss of communication)
- Common setting (loss of internal bus communication detection time)

Turn SW2-8 ON to allow programming by the PC Configurator via the Power/Network Module.


Refer to the users manual for the R8CFG for detailed operation of the software program.

EXTERNAL DIMENSIONS unit: mm (inch)

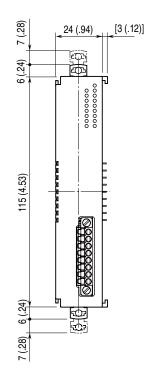

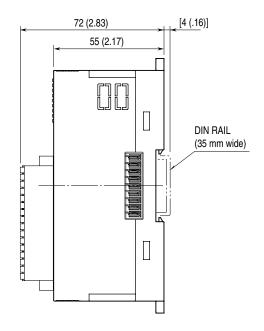

CONNECTION DIAGRAM

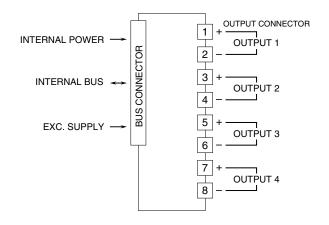

WIRING INSTRUCTIONS

```
■ TENSION CLAMP TERMINAL BLOCK

Unit side connector: MC 1,5/8-GF-3,5

(Phoenix Contact)

Cable side connector: FMC 1,5/8-STF-3,5

(Phoenix Contact)

Applicable wire size: 0.2 – 1.5 mm<sup>2</sup>

Stripped length: 10mm

Recommended solderless terminal

• AI0,25-10YE 0.25 mm<sup>2</sup> (Phoenix Contact)

• AI0,34-10TQ 0.34 mm<sup>2</sup> (Phoenix Contact)

• AI0,5-10WH 0.5 mm<sup>2</sup> (Phoenix Contact)

• AI0,75-10GY 0.75 mm<sup>2</sup> (Phoenix Contact)
```

- A1-10 1.0 mm² (Phoenix Contact)
- A1,5-10 1.5 mm² (Phoenix Contact)